



Wiring diagram **ECOTRON with relay board**

Connection control and feedback signals

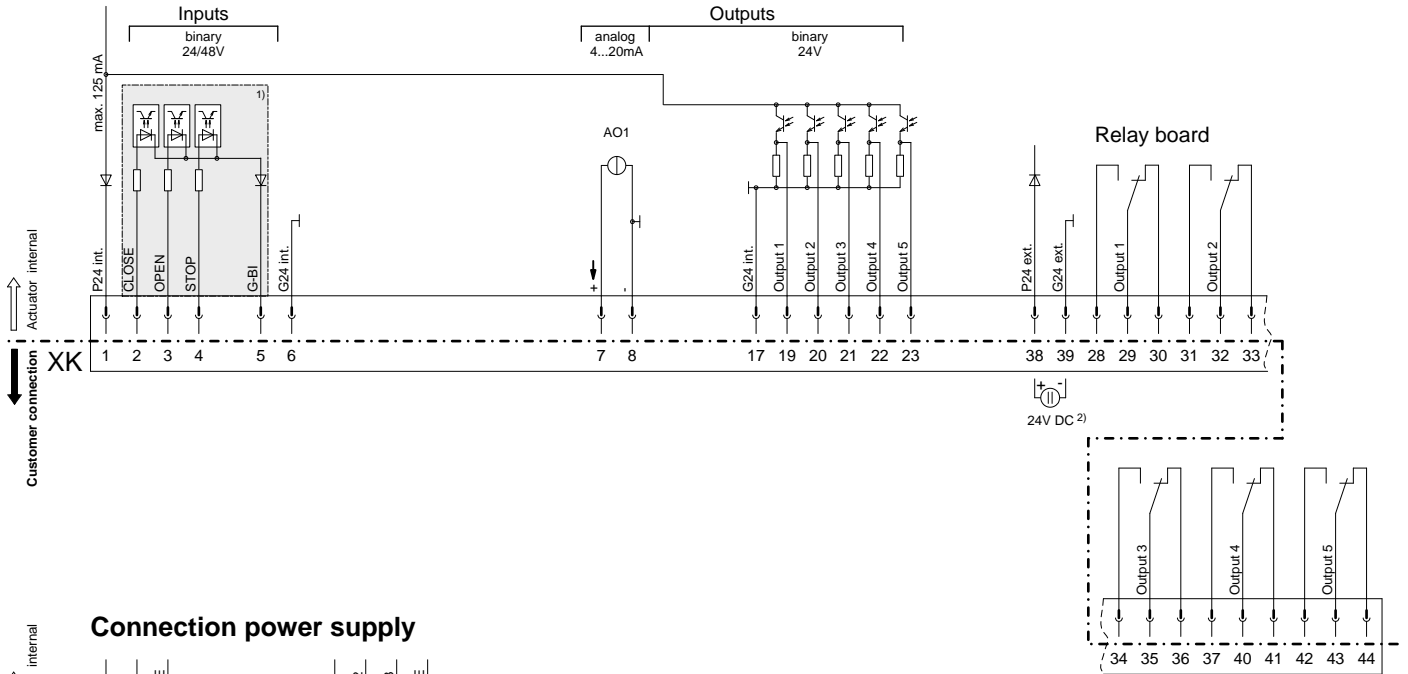

Connection power supply

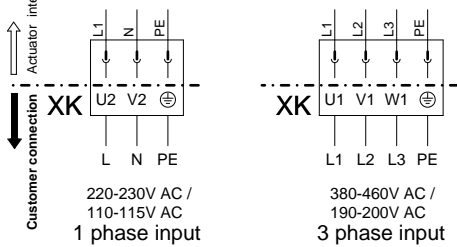

Customer connection - wiring examples:

Wiring example I: „internal 24V DC supply“

(here all inputs and outputs are supplied internally from the electronics unit with 24V DC)




Wiring example II: „external 24/48V DC supplies“

(in this example the galvanically isolated area is supplied externally from a different 24/48V DC power source)



Plug assignment XK

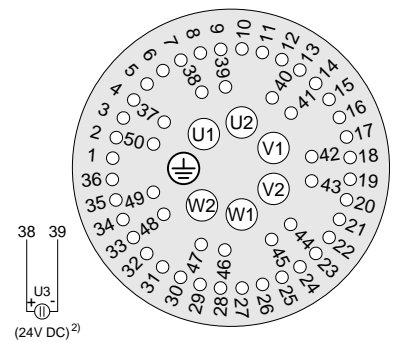

- 1) galvanically isolated area: can be supplied from different source with 24/48V DC
- 2) auxiliary 24V DC supply for electronics unit (if required)
(In case of mains failure both actual position value and actuator status (binary outputs 1-5) will continued to be signalled. Communication via COM-SIPOS – changes of parameters resp. download of actuator data – is possible.)

Wire cross-section max.:

- 6 mm² Power supply
- 2.5 mm² Control and feedback signals

The control/feedback wire **must** be shielded!