



## Wiring diagram

## PROFITRON with Fieldbus

### Connection control and feedback signals

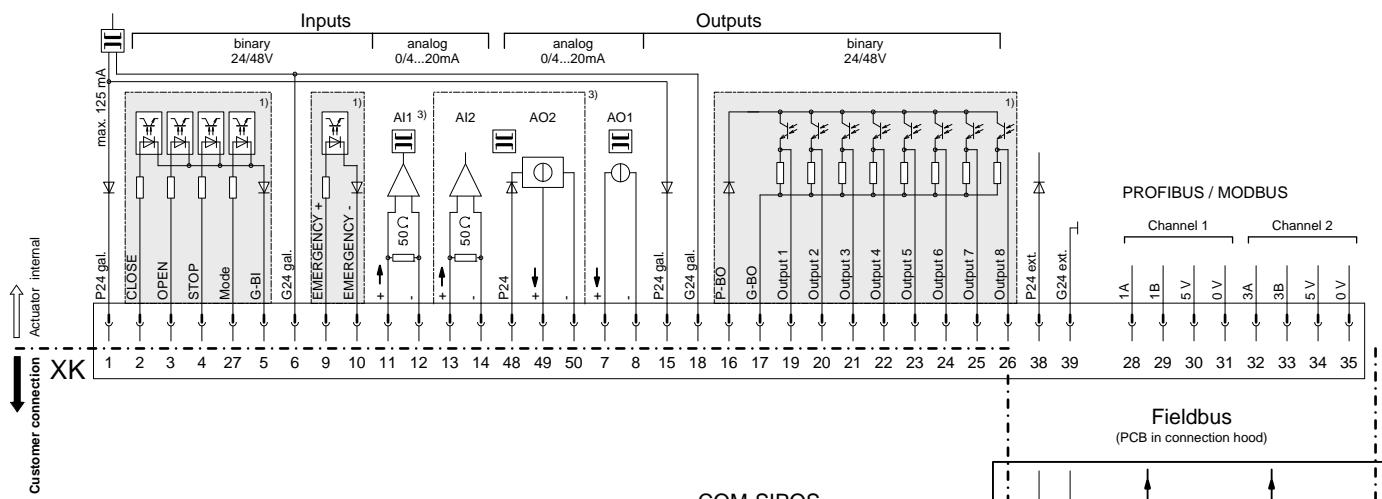


### Connection power supply

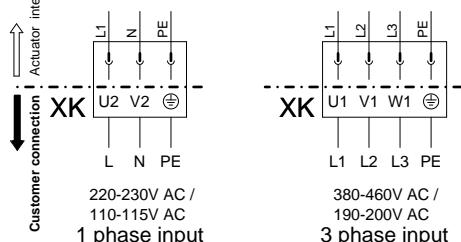


### Customer connection - wiring examples:


Wiring example I: „internal 24V DC supply“  
(here all inputs and outputs are supplied internally from the electronics unit with 24V DC)



Wiring example II: „external 24/48V DC supplies“  
(in this example all galvanically isolated areas are supplied externally from different 24/48V DC power sources)

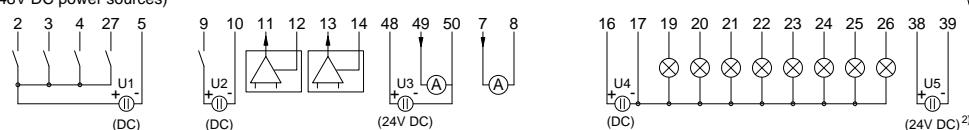

### Plug assignment XK

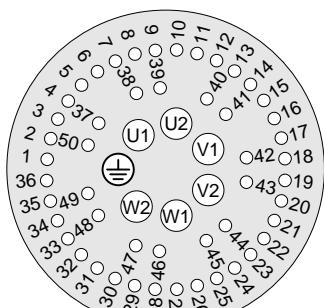

1) galvanically isolated areas: can be supplied from different sources with 24/48V DC

2) auxiliary 24V DC supply for electronics unit (if required)

(In case of mains failure both actual position value and actuator status (binary outputs 1-8) will continue to be signalled.  
Communication via COM-SIPOS or fieldbus – changes of parameters resp. download of actuator data – is possible.)

3) option

5) up to 4 connectors P24 and M on the fieldbus connection PCB

Wire cross-section max.:  
 - 6 mm<sup>2</sup> Power supply  
 - 2.5 mm<sup>2</sup> Control and feedback signals  
 The control/feedback wire **must** be shielded!